

# GRUNDFOS ALPHA2 L

Ⓒ GB Installation and operating instructions



## Declaration of Conformity

We **Grundfos** declare under our sole responsibility that the products **GRUNDFOS ALPHA2 L**, to which this declaration relates, are in conformity with the Council Directives on the approximation of the laws of the EC Member States relating to

- Machinery (98/37/EC).
- Electrical equipment designed for use within certain voltage limits (2006/95/EC).  
Standards used: EN 60335-1: 2002 and EN 60335-2-51: 2003.
- Electromagnetic compatibility (2004/108/EC).  
Standards used: EN 61000-6-2 and EN 61000-6-3.

Bjerringbro, 15th May 2008



Svend Aage Kaae  
Technical Director

# CONTENTS

	<b>Page</b>
1. Symbols used in this document .....	4
2. General description .....	5
3. Applications .....	6
4. Installation .....	8
5. Electrical connection .....	11
6. Control panel .....	12
7. Setting the pump .....	14
8. Systems with bypass valve between flow and return pipes .....	16
9. Start-up .....	18
10. Pump settings and pump performance .....	20
11. Fault finding chart .....	22
12. Technical data and installation dimensions .....	23
13. Performance curves .....	25
14. Features .....	31
15. Accessories .....	33
16. Disposal .....	34



**Warning**

***Prior to installation, read these installation and operating instructions. Installation and operation must comply with local regulations and accepted codes of good practice.***

## **1. Symbols used in this document**



**Warning**

***If these safety instructions are not observed, it may result in personal injury!***



***If these safety instructions are not observed, it may result in malfunction or damage to the equipment!***



***Notes or instructions that make the job easier and ensure safe operation.***

## 2. General description

Contents:

[2.1 The GRUNDFOS ALPHA2 L circulator pump](#)

[2.2 Advantages of installing a GRUNDFOS ALPHA2 L.](#)

### 2.1 The GRUNDFOS ALPHA2 L circulator pump

The GRUNDFOS ALPHA2 L circulator pump is designed for the circulation of water in heating systems.

Install the GRUNDFOS ALPHA2 L in

- underfloor heating systems
- one-pipe systems
- two-pipe systems.

GRUNDFOS ALPHA2 L incorporates a permanent-magnet motor and differential-pressure control enabling continuous adjustment of the pump performance to the actual system requirements.

GRUNDFOS ALPHA2 L has a user-friendly front-mounted control panel. See [6. Control panel](#) and [14. Features](#).

### 2.2 Advantages of installing a GRUNDFOS ALPHA2 L

The installation of a GRUNDFOS ALPHA2 L means

#### easy installation and start-up


- GRUNDFOS ALPHA2 L is easy to install.  
With the factory setting, the pump can, in most cases, be started without making any settings.

#### high degree of comfort

- Minimum noise from valves, etc.

#### low energy consumption

- Low energy consumption compared to conventional circulator pumps.  
The GRUNDFOS ALPHA2 L is A-labelled.

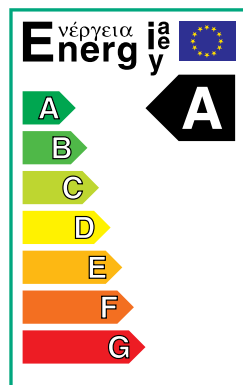

TM03 0868 0705

Fig. 1 Energy label, A-labelled

### 3. Applications

Contents:

- 3.1 System types
- 3.2 Pumped liquids
- 3.3 System pressure
- 3.4 Relative air humidity (RH)
- 3.5 Enclosure class
- 3.6 Inlet pressure.

#### 3.1 System types

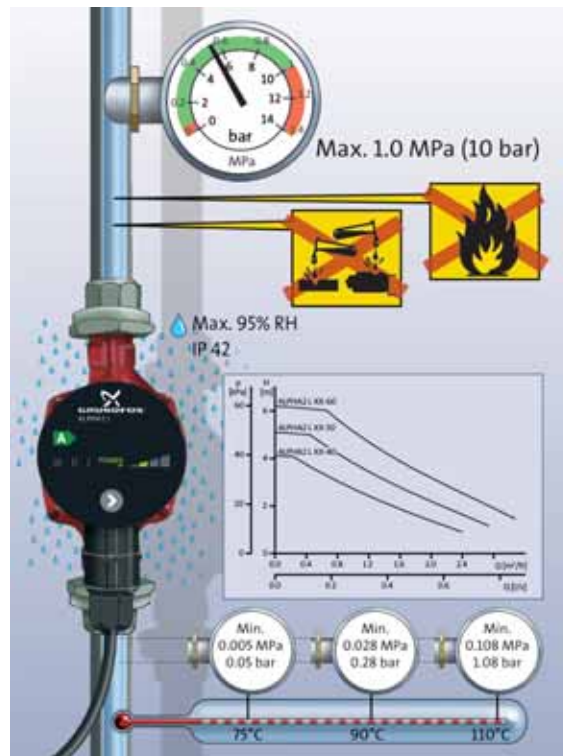


Fig. 2 Pumped liquids and operating conditions

GRUNDFOS ALPHA2 L is suitable for

- systems with **constant** or **variable flows** where it is desirable to optimise the setting of the pump duty point
- systems with **variable flow-pipe temperature**.

#### 3.2 Pumped liquids

Clean, thin, non-aggressive and non-explosive liquids, not containing solid particles, fibres or mineral oil. See fig. 2.

In **heating systems**, the water should meet the requirements of accepted standards on water quality in heating systems, e.g. the German standard VDI 2035.



#### Warning

**The pump must not be used for the transfer of flammable liquids such as diesel oil, petrol and similar liquids.**

TM04 2521 2608

### 3.3 System pressure

Maximum 1.0 MPa (10 bar). See fig. 2.

### 3.4 Relative air humidity (RH)

Maximum 95 %. See fig. 2.

### 3.5 Enclosure class

IP 42. See fig. 2.

### 3.6 Inlet pressure

Minimum inlet pressure in relation to liquid temperature. See fig. 2.

Liquid temperature	Minimum inlet pressure	
	[MPa]	[bar]
$\leq 75$ °C	0.005	0.05
90 °C	0.028	0.28
110 °C	0.108	1.08

## 4. Installation

Contents:


[4.1 Mounting](#)

[4.2 Control box positions](#)

[4.3 Changing the control box position](#)

[4.4 Insulation of pump housing.](#)

### 4.1 Mounting

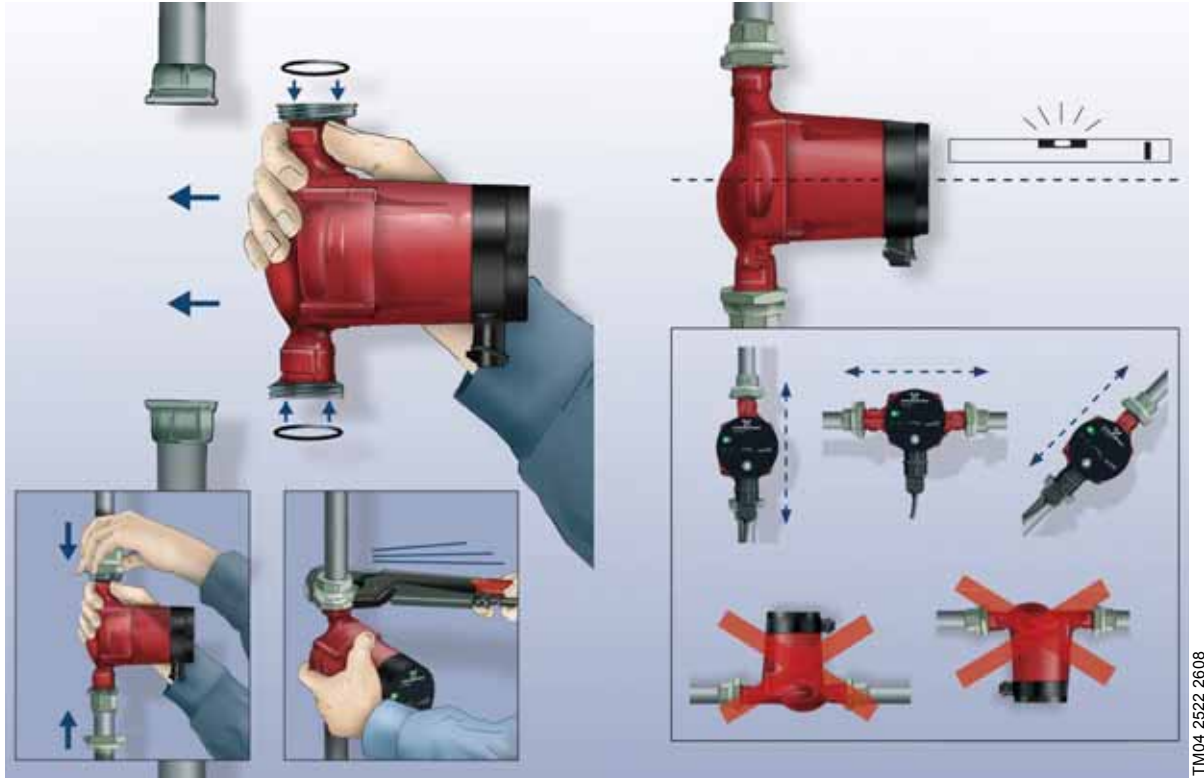

**Fig. 3** Mounting the GRUNDFOS ALPHA2 L

Arrows on the pump housing indicate the liquid flow direction through the pump.

See [12.2 Installation dimensions – GRUNDFOS ALPHA2 L XX-40, XX-50, XX-60.](#)

1. Fit the two gaskets supplied when the pump is mounted in the pipe. See fig. 3, pos. A.
2. Install the pump with the motor shaft horizontal. See fig. 3, pos. B.

TM04 2522 2608



## 4.2 Control box positions

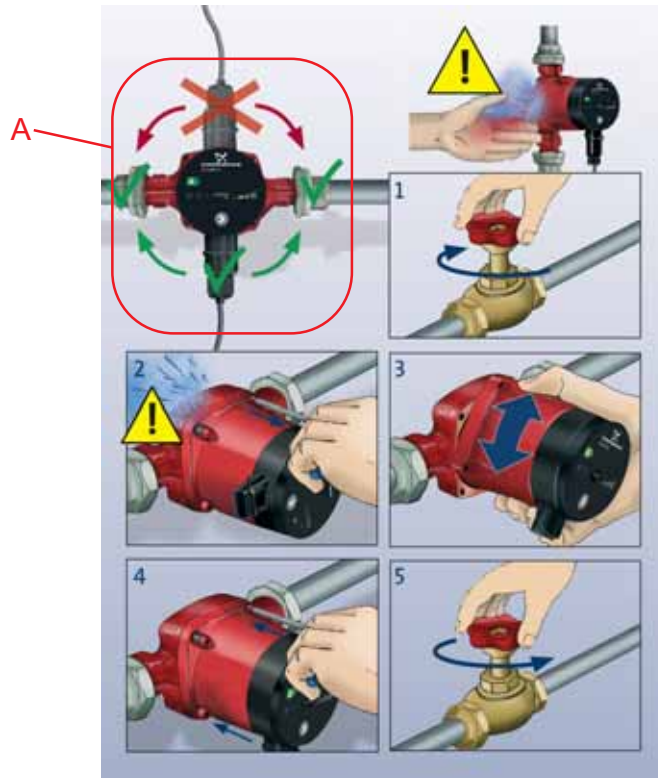


Fig. 4 Control box positions



### **Warning**

*The pumped liquid may be scalding hot and under high pressure! Drain the system or close the isolating valves on either side of the pump before the screws are removed.*



*When the position of the control box has been changed, fill the system with the liquid to be pumped or open the isolating valves.*

## 4.3 Changing the control box position

The control box can be rotated in steps of 90 °.

Possible/permissible positions and the procedure of changing the position of the control box are illustrated in fig. 4, pos. A.

Procedure:

1. Slacken and remove the four hexagon-socket head screws holding the pump head with a tee key (M4).
2. Turn the pump head to the desired position.
3. Insert and cross-tighten the screws.

## 4.4 Insulation of pump housing



**Fig. 5** Insulation of pump housing

**Note**

***Limit the heat loss from the pump housing and pipework.***

The heat loss from the pump and pipework can be reduced by insulating the pump housing and the pipe. See fig. 5.


As an alternative, polystyrene insulation shells can be ordered from Grundfos. See [15. Accessories](#).

**Caution**

***Do not insulate the control box or cover the control panel.***

TM04.2524.2608

## 5. Electrical connection

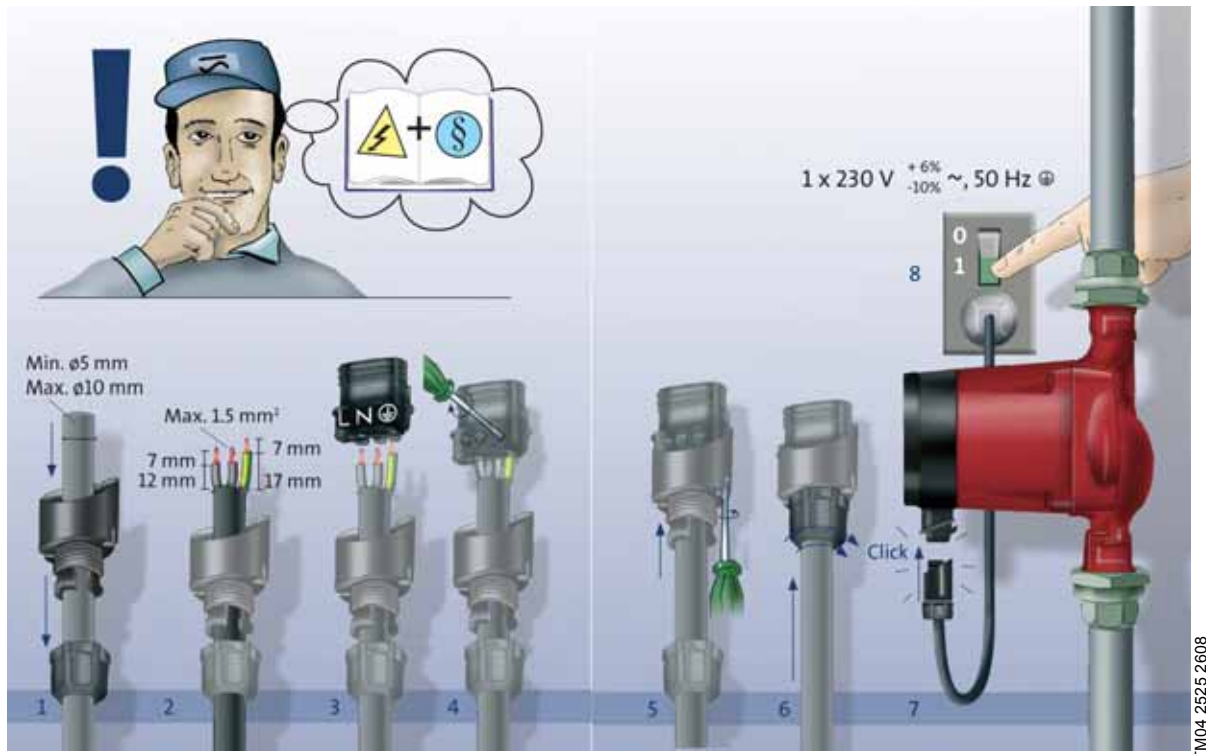

**Fig. 6** Electrical connection

The electrical connections and protection must be carried out in accordance with local regulations.

### **Warning**



**The pump must be connected to earth** .

**The pump must be connected to an external mains switch with a minimum contact gap of 3 mm in all poles.**

- The motor requires no external motor protection.
- Check that the supply voltage and frequency correspond to the values stated on the pump. See [14.1 Nameplate](#).
- Connect the pump to the mains with the plug supplied with the pump as shown in fig. 6, steps 1 to 8.
- Light in the control panel shows that the electricity supply has been switched on.

## 6. Control panel

Contents:


[6.1 Elements on the control panel](#)

[6.2 "POWER ON" indicator light](#)

[6.3 Light fields indicating the pump setting](#)

[6.4 Push-button for selection of pump setting.](#)

### 6.1 Elements on the control panel

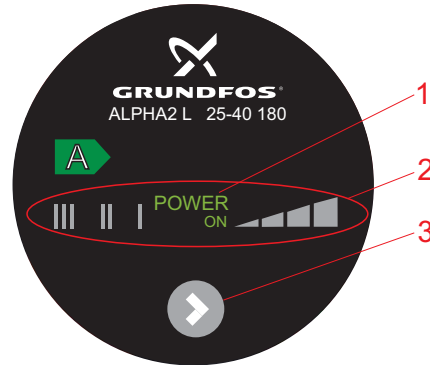

TM04 2526 2608

**Fig. 7** GRUNDFOS ALPHA2 L control panel

The control panel on the GRUNDFOS ALPHA2 L comprises:

Pos.	Description
1	"POWER ON" indicator light
2	Seven light fields indicating the pump setting
3	Push-button for selection of pump setting

### 6.2 "POWER ON" indicator light

The "POWER ON" indicator light, see fig. 7, pos. 1, is on when the electricity has been switched on.


When the "POWER ON" indicator light is on only, a fault preventing the pump from operating properly (e.g. seizing-up) has occurred.

If a fault is indicated, correct the fault and reset the pump by switching the electricity supply off and on.

### 6.3 Light fields indicating the pump setting

GRUNDFOS ALPHA2 L has seven optional settings which can be selected with the push-button. See fig. 7, pos. 3.

The pump setting is indicated by seven different light fields. See fig. 8.

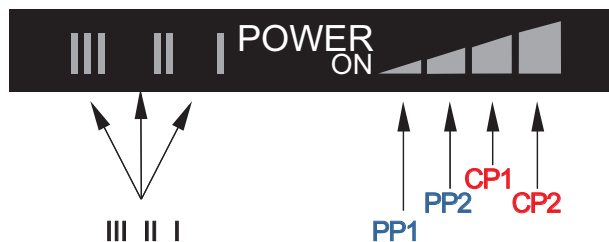

TM04 2527 2608

**Fig. 8** Seven light fields

Button presses	Light field	Description
0	PP2 (factory setting)	Highest proportional-pressure curve
1	CP1	Lowest constant-pressure curve
2	CP2	Highest constant-pressure curve
3	III	Constant curve, speed III
4	II	Constant curve, speed II
5	I	Constant curve, speed I
6	PP1	Lowest proportional-pressure curve
7	PP2	Highest proportional-pressure curve

See [10. Pump settings and pump performance](#) for information about the function of the settings.

### 6.4 Push-button for selection of pump setting

Every time the push-button is pressed, see fig. 7, pos. 3, the pump setting is changed.

A cycle is seven button presses. See [6.3 Light fields indicating the pump setting](#).


## 7. Setting the pump

Contents:

[7.1 Pump setting for system type](#)

[7.2 Pump control.](#)

### 7.1 Pump setting for system type

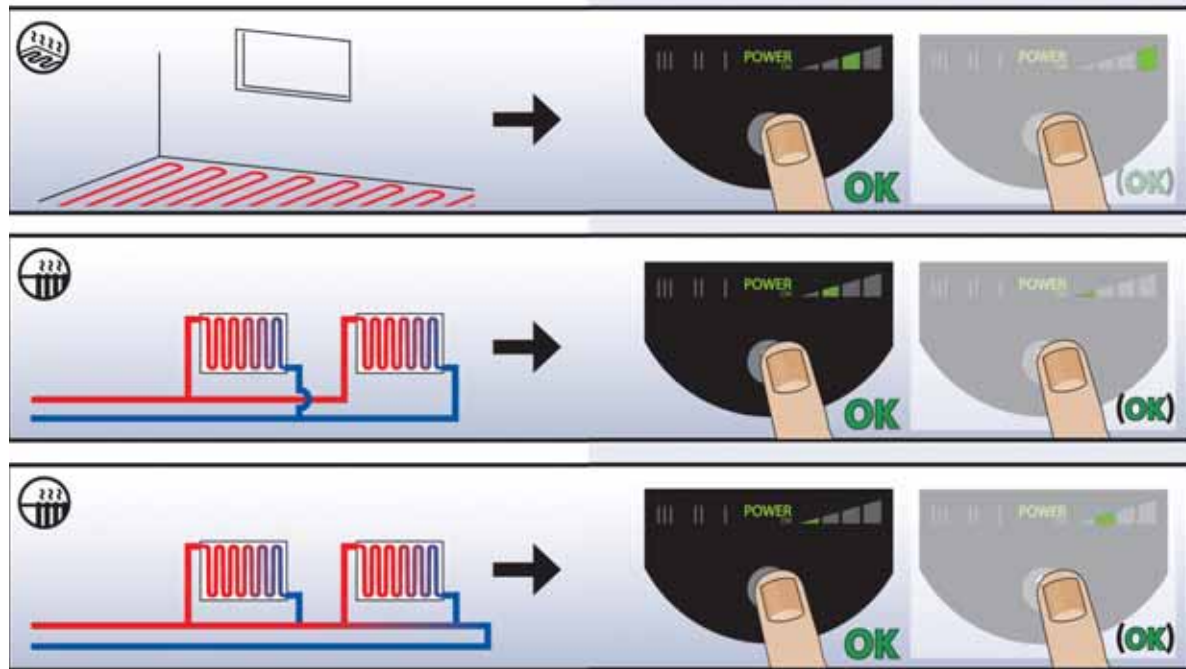

**Fig. 9** Selection of pump setting for system type

Factory setting = Highest proportional-pressure curve (PP2).

Recommended and alternative pump settings according to fig. 9:

Pos.	System type	Pump setting	
		Recommended	Alternative
A	Underfloor heating	Lowest constant-pressure curve (CP1)*	Highest constant-pressure curve (CP2)*
B	Two-pipe systems	Highest proportional-pressure curve (PP2)*	Lowest proportional-pressure curve (PP1)*
C	One-pipe systems	Lowest proportional-pressure curve (PP1)*	Highest proportional-pressure curve (PP2)*

\* See [13.1 Guide to performance curves.](#)

#### Changing from recommended to alternative pump setting

Heating systems are "slow" systems that cannot be set to the optimum operation within minutes or hours.

If the recommended pump setting does not give the desired distribution of heat in the rooms of the house, change the pump setting to the shown alternative.

Explanation to pump settings in relation to performance curves, see [10. Pump settings and pump performance.](#)

## 7.2 Pump control

During operation, the pump head will be controlled according to the principle "proportional-pressure control" (PP) or "constant-pressure control" (CP).

In these control modes, the pump performance and consequently the power consumption are adjusted according to the heat demand in the system.

### **Proportional-pressure control**

In this control mode, the differential pressure across the pump is controlled according to the flow.

The proportional-pressure curves are indicated by PP1 and PP2 in the Q/H diagrams. See [10. Pump settings and pump performance](#).

### **Constant-pressure control**

In this control mode, a constant differential pressure across the pump is maintained, irrespective of the flow.

The constant-pressure curves are indicated by CP1 and CP2 and are the horizontal performance curves in the Q/H diagrams. See [10. Pump settings and pump performance](#).

## 8. Systems with bypass valve between flow and return pipes


Contents:

[8.1 Purpose of bypass valve](#)

[8.2 Manually operated bypass valve](#)

[8.3 Automatic bypass valve \(thermostatically controlled\).](#)

### 8.1 Purpose of bypass valve

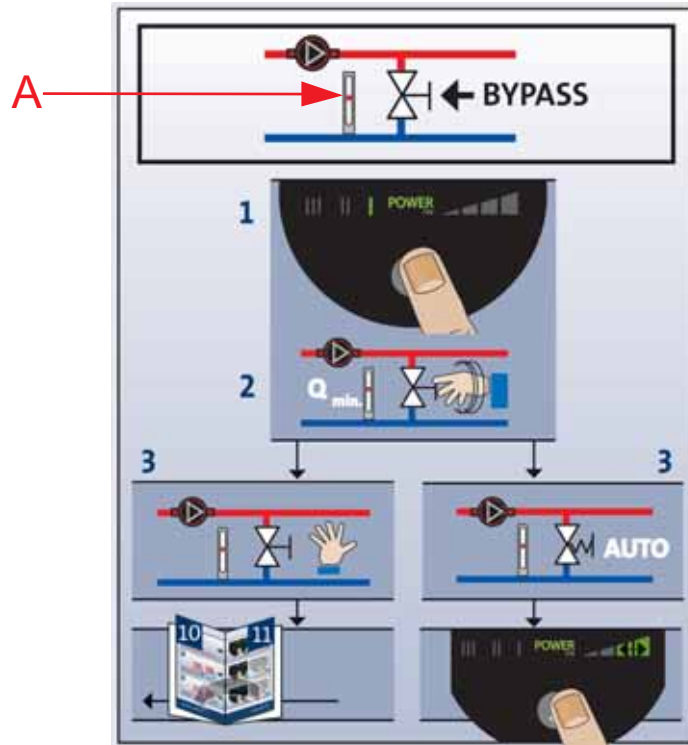

**Fig. 10** Systems with bypass valve

#### Bypass valve

The purpose of the bypass valve is to ensure that the heat from the boiler can be distributed when all valves in the underfloor-heating circuits and/or thermostatic radiator valves are closed.

System elements:

- bypass valve
- flowmeter, pos. A.

The minimum flow must be present when all valves are closed.

The pump setting depends on the type of bypass valve used, i.e. manually operated or thermostatically controlled.

### 8.2 Manually operated bypass valve

Follow this procedure:

1. Adjust the bypass valve with the pump in setting I (speed I). The minimum flow ( $Q_{\min.}$ ) for the system must always be observed. Consult the manufacturer's instructions.
2. When the bypass valve has been adjusted, set the pump according to [7. Setting the pump.](#)

TM04 2529 2608



### 8.3 Automatic bypass valve (thermostatically controlled)

Follow this procedure:

1. Adjust the bypass valve with the pump in setting I (speed I).  
The minimum flow ( $Q_{\min.}$ ) for the system must always be observed.  
Consult the manufacturer's instructions.
2. When the bypass valve has been adjusted, set the pump to the lowest or highest constant-pressure curve.  
Explanation to pump settings in relation to performance curves, see [10. Pump settings and pump performance](#).

## 9. Start-up

Contents:

[9.1 Before start-up](#)

[9.2 Venting the pump](#)

[9.3 Venting of heating systems.](#)

### 9.1 Before start-up

Do not start the pump until the system has been filled with liquid and vented. The required minimum inlet pressure must be available at the pump inlet. See [3. Applications](#) and [12. Technical data and installation dimensions](#).

### 9.2 Venting the pump



TMD4 2530 2608

**Fig. 11** Venting the pump

The pump is self-venting. It need not be vented before start-up.

Air in the pump may cause noise. This noise ceases after a few minutes running.

Quick venting of the pump can be obtained by setting the pump to speed III for a short period, depending on system size and design.

When the pump has been vented, i.e. when the noise has ceased, set the pump according to the recommendations. See [7. Setting the pump](#).

**Caution** *The pump must not run dry.*

The system cannot be vented through the pump. See [9.3 Venting of heating systems](#).

## 9.3 Venting of heating systems



TM04 2531 2608

**Fig. 12** Venting of heating systems

The heating system can be vented via an air escape valve installed above the pump (1).

In heating systems that often contain much air, Grundfos recommends the installation of pumps with pump housing with air separator, i.e. ALPHA2 pumps, type ALPHA2 XX-XX A.

When the heating system has been filled with liquid, follow this procedure:

1. Open the air escape valve.
2. Set the pump to speed III.
3. Let the pump run for a short period, depending on system size and design.
4. When the system has been vented, i.e. when the possible noise has ceased, set the pump according to the recommendations. See [7. Setting the pump](#).

Repeat the procedure, if necessary.

**Caution** *The pump must not run dry.*

## 10. Pump settings and pump performance

Contents:

[10.1 Relation between pump setting and pump performance.](#)

### 10.1 Relation between pump setting and pump performance

Figure 13 shows the relation between pump setting and pump performance by means of curves. See also [13. Performance curves.](#)

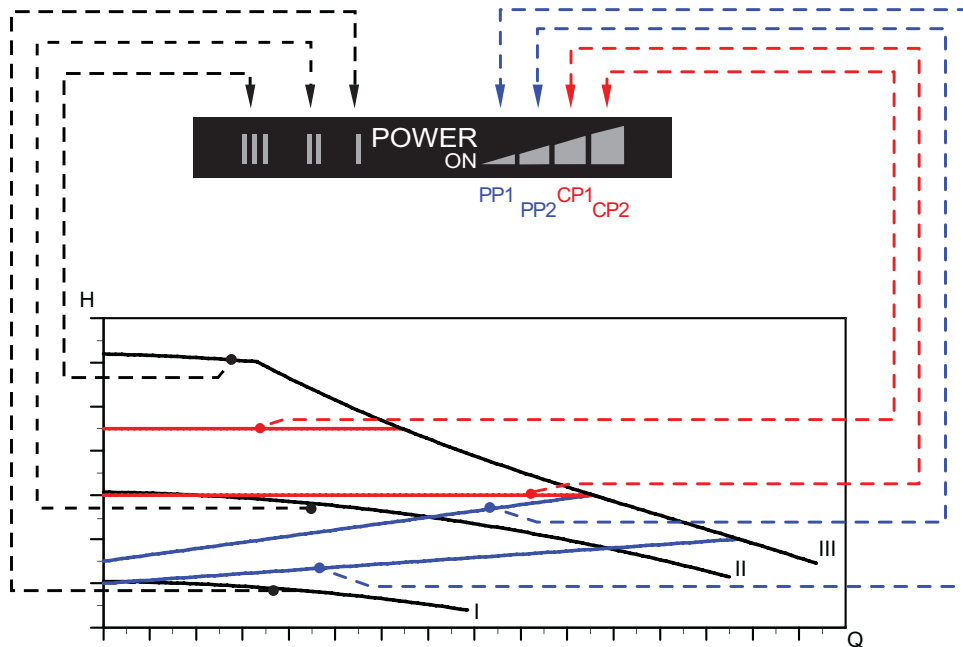


Fig. 13 Pump setting in relation to pump performance

TM04 2532 2608

Setting	Pump curve	Function
PP1	Lowest proportional-pressure curve	The duty point of the pump will move up or down on the lowest proportional-pressure curve, see fig. 13, depending on the heating demand. The head (pressure) is reduced at falling heating demand and increased at rising heating demand.
PP2 (factory setting)	Highest proportional-pressure curve	The duty point of the pump will move up or down on the highest proportional-pressure curve, see fig. 13, depending on the heating demand. The head (pressure) is reduced at falling heating demand and increased at rising heating demand.
CP1	Lowest constant-pressure curve	The duty point of the pump will move out or in on the lowest constant-pressure curve, see fig. 13, depending on the heating demand in the system. The head (pressure) is kept constant, irrespective of the heating demand.
CP2	Highest constant-pressure curve	The duty point of the pump will move out or in on the highest constant-pressure curve, see fig. 13, depending on the heating demand in the system. The head (pressure) is kept constant, irrespective of the heating demand.
III	Speed III	ALPHA2 L runs at a constant speed and consequently on a constant curve. In speed III, the pump is set to run on the max. curve under all operating conditions. See fig. 13. Quick venting of the pump can be obtained by setting the pump to speed III for a short period. See <a href="#">9.2 Venting the pump.</a>

<b>Setting</b>	<b>Pump curve</b>	<b>Function</b>
II	Speed II	ALPHA2 L runs at a constant speed and consequently on a constant curve. In speed II, the pump is set to run on the medium curve under all operating conditions. See fig. 13.
I	Speed I	ALPHA2 L runs at a constant speed and consequently on a constant curve. In speed I, the pump is set to run on the min. curve under all operating conditions. See fig. 13.

## 11. Fault finding chart



### Warning

**Before starting any work on the pump, make sure that the electricity supply has been switched off and that it cannot be accidentally switched on.**

Fault	Control panel	Cause	Remedy
1. The pump does not run.	Light off.	a) One fuse in the installation is blown.	Replace the fuse.
		b) The current-operated or voltage-operated circuit breaker has tripped out.	Cut in the circuit breaker.
		c) The pump is defective.	Replace the pump.
2. Noise in the system.	"POWER ON" is on only.	a) Electricity supply failure. Might be too low.	Check that the electricity supply falls within the specified range.
		b) The pump is blocked.	Remove the impurities.
2. Noise in the system.	"POWER ON" and the light field for pump setting are on.	a) Air in the system.	Vent the system. See <a href="#">9.3 Venting of heating systems</a> .
		b) The flow is too high.	Reduce the suction head. See <a href="#">10. Pump settings and pump performance</a> .
3. Noise in the pump.	"POWER ON" and the light field for pump setting are on.	a) Air in the pump.	Let the pump run. It vents itself over time. See <a href="#">9.2 Venting the pump</a> .
		b) The inlet pressure is too low.	Increase the inlet pressure or check the air volume in the expansion tank, if installed.
4. Insufficient heat.	"POWER ON" and the light field for pump setting are on.	a) The pump performance is too low.	Increase the suction head. See <a href="#">10. Pump settings and pump performance</a> .

## 12. Technical data and installation dimensions

Contents:

[12.1 Technical data](#)

[12.2 Installation dimensions – GRUNDFOS ALPHA2 L XX-40, XX-50, XX-60.](#)


### 12.1 Technical data

Supply voltage	1 x 230 V – 10 %/+ 6 %, 50 Hz, PE	
Motor protection	The pump requires no external motor protection.	
Enclosure class	IP 42	
Insulation class	F	
Relative air humidity	Maximum 95 %	
System pressure	Maximum 1.0 MPa, 10 bar, 102 m head	
Inlet pressure	<b>Liquid temperature</b>	<b>Minimum inlet pressure</b>
	≤+75 °C	0.05 bar, 0.005 MPa, 0.5 m head
	+90 °C	0.28 bar, 0.028 MPa, 2.8 m head
	+110 °C	1.08 bar, 0.108 MPa, 10.8 m head
EMC	EN 61000-6-2 and EN 61000-6-3	
Sound pressure level	The sound pressure level of the pump is lower than 43 dB(A).	
Ambient temperature	0 °C to +40 °C	
Temperature class	TF110 to CEN 335-2-51	
Surface temperature	The maximum surface temperature will not exceed +125 °C.	
Liquid temperature	+2 °C to +110 °C	

To avoid condensation in the control box and stator, the liquid temperature must always be higher than the ambient temperature.

Ambient temperature [°C]	Liquid temperature	
	Min. [°C]	Max. [°C]
0	2	110
10	10	110
20	20	110
30	30	110
35	35	90
40	40	70

## 12.2 Installation dimensions – GRUNDFOS ALPHA2 L XX-40, XX-50, XX-60

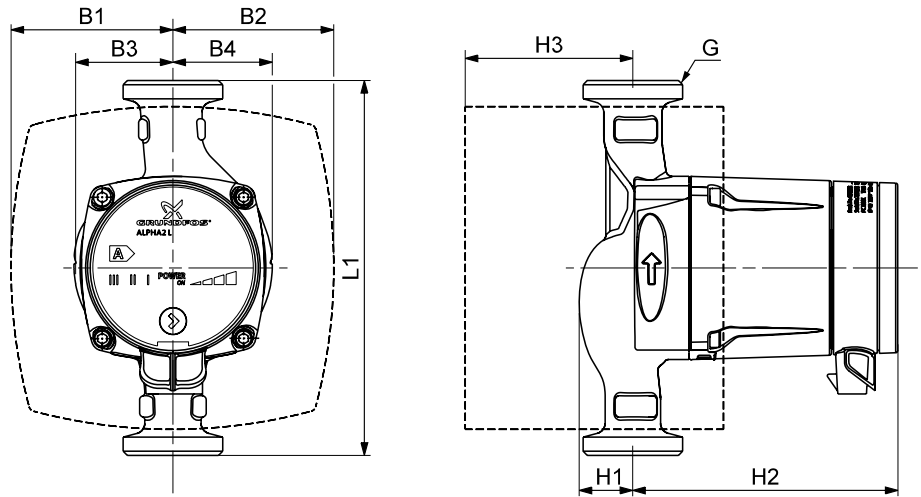

TM04 2533 2608

**Fig. 14** Dimensional sketches, ALPHA2 L XX-40, XX-50, XX-60

Pump type	Dimensions									
	L1	B1	B2	B3	B4	H1	H2	H3	G	
ALPHA2 L 15-40 130	130	77	78	46	49	27	129	79	1	
ALPHA2 L 15-50 130*	130	77	78	46	49	27	129	79	1 1/2	
ALPHA2 L 25-40 130	130	77	78	46	49	27	129	79	1 1/2	
ALPHA2 L 25-40 180	180	78	77	47	48	26	127	81	1 1/2	
ALPHA2 L 32-40 180	180	78	77	47	48	26	127	81	2	
ALPHA2 L 15-60 130	130	77	78	46	49	27	129	79	1**	
ALPHA2 L 25-60 130	130	77	78	46	49	27	129	79	1 1/2	
ALPHA2 L 25-60 180	180	78	77	47	48	26	127	81	1 1/2	
ALPHA2 L 32-60 180	180	78	77	47	48	26	127	81	2	

\*) For the UK market only. \*\*) For UK 1 1/2.



## 13. Performance curves

Contents:

[13.1 Guide to performance curves](#)

[13.2 Curve conditions](#)

[13.3 Performance curves, ALPHA2 L XX-40](#)

[13.4 Performance curves, ALPHA2 L XX-50](#)


[13.5 Performance curves, ALPHA2 L XX-60.](#)

## 13.1 Guide to performance curves

Each pump setting has its own performance curve (Q/H curve).

A power curve (P1 curve) belongs to each Q/H curve. The power curve shows the pump power consumption (P1) in Watt at a given Q/H curve.

The P1 value corresponds to the value that can be read from the pump display, see fig. 15:

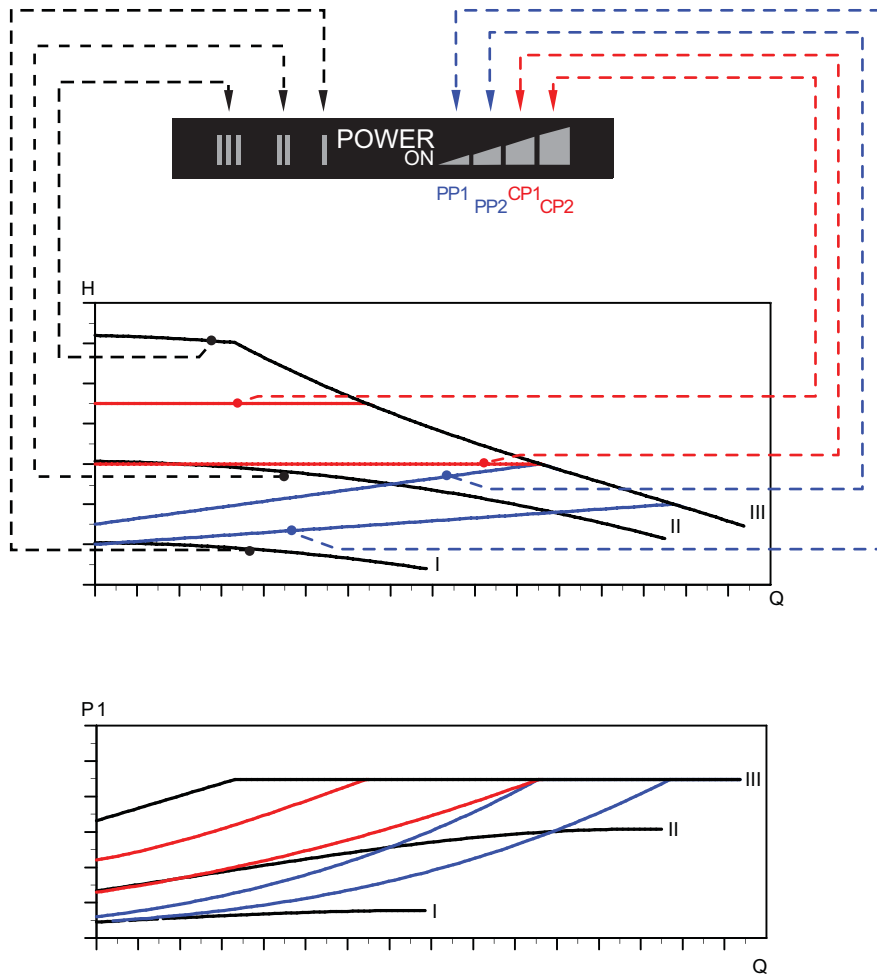

TM04 2534 2608

**Fig. 15** Performance curves in relation to pump setting

Setting	Pump curve
PP1	Lowest proportional-pressure curve
PP2 (factory setting)	Highest proportional-pressure curve
CP1	Lowest constant-pressure curve
CP2	Highest constant-pressure curve
III	Constant speed, speed III
II	Constant speed, speed II
I	Constant speed, speed I

For further information about pump settings, see

[6.3 Light fields indicating the pump setting](#)

[7. Setting the pump](#)

[10. Pump settings and pump performance.](#)

## 13.2 Curve conditions

The guidelines below apply to the curves on the next pages:

- Test liquid: Airless water.
- The curves apply to a density of  $\rho = 983.2 \text{ kg/m}^3$  and a liquid temperature of  $+60 \text{ }^\circ\text{C}$ .
- All curves show average values and should not be used as guarantee curves. If a specific minimum performance is required, individual measurements must be made.
- The curves for speeds I, II and III are marked.
- The curves apply to a kinematic viscosity of  $\nu = 0.474 \text{ mm}^2/\text{s}$  (0.474 cSt).

### 13.3 Performance curves, ALPHA2 L XX-40


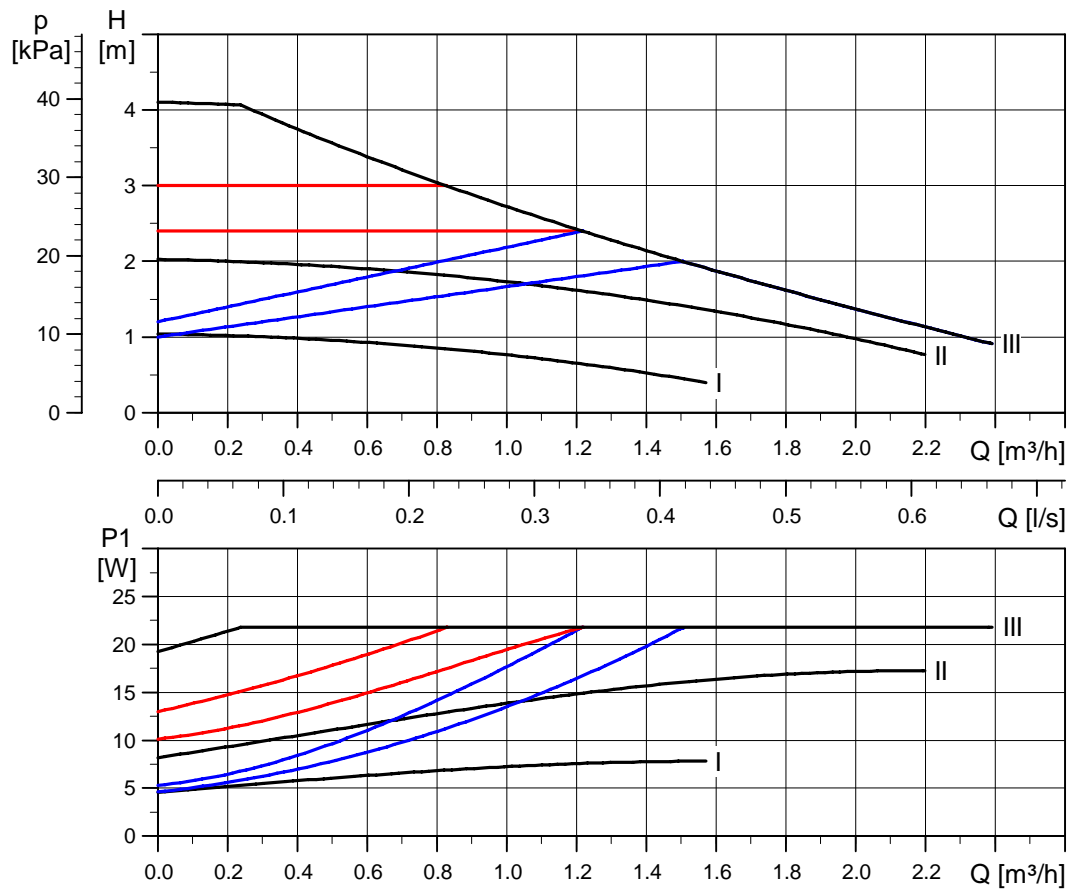


Fig. 16 Performance curves, ALPHA2 L XX-40

TM04 2110 2008

### 13.4 Performance curves, ALPHA2 L XX-50

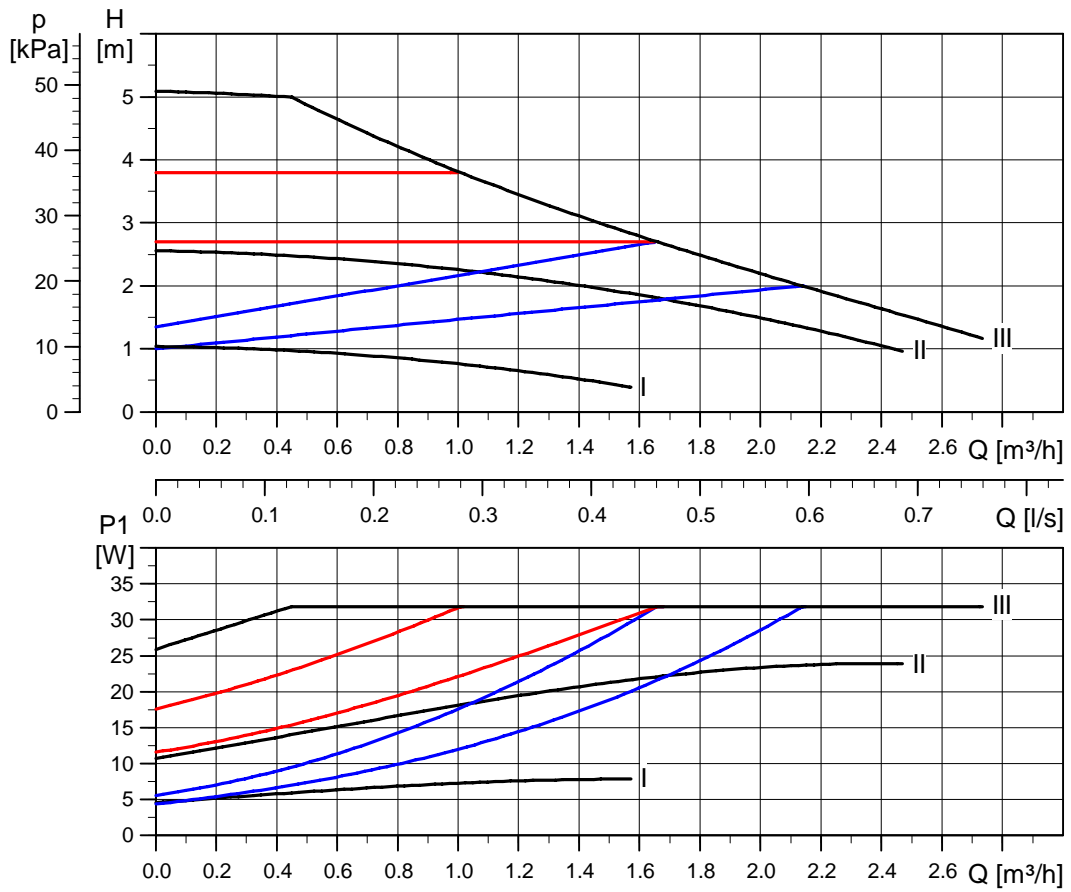

**Fig. 17** Performance curves, ALPHA2 L XX-50

TM04 2109 2008

### 13.5 Performance curves, ALPHA2 L XX-60

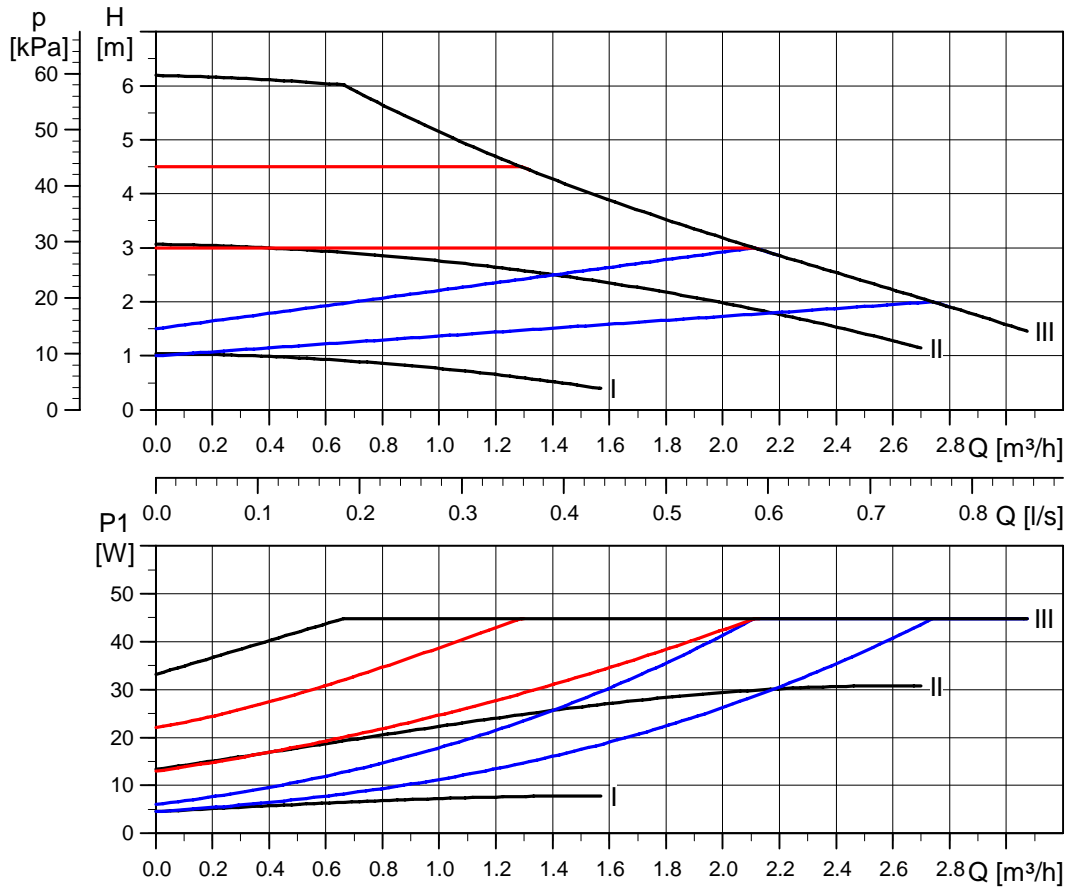


Fig. 18 Performance curves, ALPHA2 L XX-60

TM04 2108 2008

## 14. Features

Contents:

[14.1 Nameplate](#)

[14.2 Type key.](#)

### 14.1 Nameplate

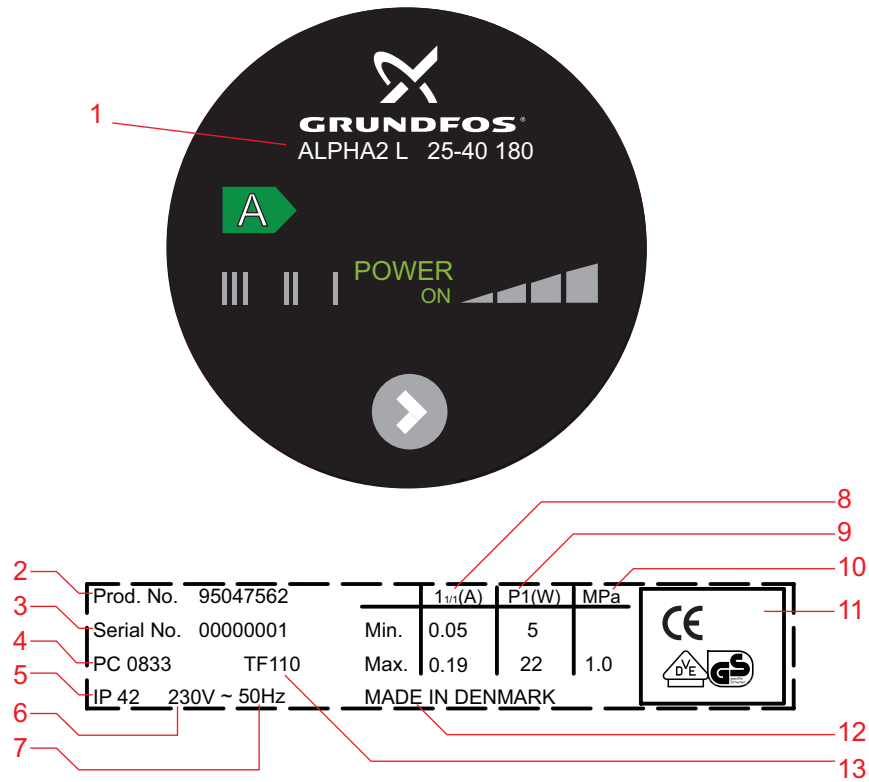


Fig. 19 Nameplate, GRUNDFOS ALPHA2 L

Pos.	Description	Pos.	Description
1	Pump type	8	Rated current [A]: • Min.: Minimum current [A] • Max.: Maximum current [A]
2	Product number	9	Input power $P_1$ [W]: • Min.: Minimum input power $P_1$ [W] • Max.: Maximum input power $P_1$ [W]
3	Serial number	10	Maximum system pressure [MPa]
4	Production code • 1st and 2nd figures = year • 3rd and 4th figures = week	11	CE mark and approvals
5	Enclosure class	12	Country of origin
6	Voltage [V]	13	Temperature class
7	Frequency [Hz]		

TM04 2535 2608

### 14.2 Type key

Example	ALPHA2 L	25	-40	180
Pump type				
Nominal diameter (DN) of suction and discharge ports [mm]				
Maximum head [dm]				
Port-to-port length [mm]				



# 15. Accessories



TM04 2536 2608

**Fig. 20** Accessories

Accessories for GRUNDFOS ALPHA2 L. See fig. 20.

Accessories include

- fittings (unions and valves)
- insulation kits (insulation shells)
- plug.

## 16. Disposal

This product or parts of it must be disposed of in an environmentally sound way:

1. Use the public or private waste collection service.
2. If this is not possible, contact the nearest Grundfos company or service workshop.

**Argentina**

Bombas GRUNDFOS de Argentina S.A.  
Ruta Panamericana km. 37.500 Lote  
34A  
1619 - Garin  
Pcia. de Buenos Aires  
Phone: +54-3327 414 444  
Telefax: +54-3327 411 111

**Australia**

GRUNDFOS Pumps Pty. Ltd.  
P.O. Box 2040  
Regency Park  
South Australia 5942  
Phone: +61-8-8461-4611  
Telefax: +61-8-8340 0155

**Austria**

GRUNDFOS Pumpen Vertrieb  
Ges.m.b.H.  
Grundfosstraße 2  
A-5082 Grödig/Salzburg  
Tel.: +43-6246-883-0  
Telefax: +43-6246-883-30

**Belgium**

N.V. GRUNDFOS Bellux S.A.  
Boomsesteenweg 81-83  
B-2630 Aartselaar  
Tél.: +32-3-870 7300  
Télécopie: +32-3-870 7301

**Belorussia**

Представительство ГРУНДФОС в  
Минске  
220090 Минск ул.Олешева 14  
Телефон: (8632) 62-40-49  
Факс: (8632) 62-40-49

**Bosnia/Herzegovina**

GRUNDFOS Sarajevo  
Paromlinska br. 16,  
BiH-71000 Sarajevo  
Phone: +387 33 713290  
Telefax: +387 33 231795

**Brazil**

Mark GRUNDFOS Ltda.  
Av. Humberto de Alencar Castelo  
Branco, 630  
CEP 09850 - 300  
São Bernardo do Campo - SP  
Phone: +55-11 4393 5533  
Telefax: +55-11 4343 5015

**Bulgaria**

GRUNDFOS Pumpen Vertrieb  
Representative Office - Bulgaria  
Bulgaria, 1421 Sofia  
Lozenetz District  
105-107 Arsenalski blvd.  
Phone: +359 2963 3820, 2963 5653  
Telefax: +359 2963 1305

**Canada**

GRUNDFOS Canada Inc.  
2941 Brighton Road  
Oakville, Ontario  
L6H 6C9  
Phone: +1-905 829 9533  
Telefax: +1-905 829 9512

**China**

GRUNDFOS Pumps (Shanghai) Co. Ltd.  
51 Floor, Raffles City  
No. 268 Xi Zang Road. (M)  
Shanghai 200001  
PRC  
Phone: +86-021-612 252 22  
Telefax: +86-021-612 253 33

**Croatia**

GRUNDFOS predstavništvo Zagreb  
Cebini 37, Buzin  
HR-10000 Zagreb  
Phone: +385 1 6595 400  
Telefax: +385 1 6595 499

**Czech Republic**

GRUNDFOS s.r.o.  
Čajkovského 21  
779 00 Olomouc  
Phone: +420-585-716 111  
Telefax: +420-585-716 299

**Denmark**

GRUNDFOS DK A/S  
Martin Bachs Vej 3  
DK-8850 Bjerringbro  
Tlf.: +45-87 50 50 50  
Telefax: +45-87 50 51 51  
E-mail: info\_GDK@grundfos.com  
www.grundfos.com/DK

**Estonia**

GRUNDFOS Pumps Eesti OÜ  
Peterburi tee 92G  
11415 Tallinn  
Tel: + 372 606 1690  
Fax: + 372 606 1691

**Finland**

OY GRUNDFOS Pumput AB  
Mestarintie 11  
FIN-01730 Vantaa  
Phone: +358-3066 5650  
Telefax: +358-3066 56550

**France**

Pompes GRUNDFOS Distribution S.A.  
Parc d'Activités de Chesnes  
57, rue de Malacombe  
F-38290 St. Quentin Fallavier (Lyon)  
Tél.: +33-4 74 82 15 15  
Télécopie: +33-4 74 94 10 51

**Germany**

GRUNDFOS GMBH  
Schlüterstr. 33  
40699 Erkrath  
Tel.: +49-(0) 211 929 69-0  
Telefax: +49-(0) 211 929 69-3799  
e-mail: infoservice@grundfos.de  
Service in Deutschland:  
e-mail: kundendienst@grundfos.de

**Greece**

GRUNDFOS Hellas A.E.B.E.  
20th km. Athinon-Markopoulou Av.  
P.O. Box 71  
GR-19002 Peania  
Phone: +0030-210-66 83 400  
Telefax: +0030-210-66 46 273

**Hong Kong**

GRUNDFOS Pumps (Hong Kong) Ltd.  
Unit 1, Ground floor  
Siu Wai Industrial Centre  
29-33 Wing Hong Street &  
68 King Lam Street, Cheung Sha Wan  
Kowloon  
Phone: +852-27861706 / 27861741  
Telefax: +852-27858664

**Hungary**

GRUNDFOS Hungária Kft.  
Park u. 8  
H-2045 Törökbálint,  
Phone: +36-23 511 110  
Telefax: +36-23 511 111

**India**

GRUNDFOS Pumps India Private Limited  
118 Old Mahabalipuram Road  
Thoraipakkam  
Chennai 600 096  
Phone: +91-44 2496 6800

**Indonesia**

PT GRUNDFOS Pompa  
Jl. Rawa Sumur III, Blok III / CC-1  
Kawasan Industri, Pulogadung  
Jakarta 13930  
Phone: +62-21-460 6909  
Telefax: +62-21-460 6910 / 460 6901

**Ireland**

GRUNDFOS (Ireland) Ltd.  
Unit A, Merrywell Business Park  
Ballymount Road Lower  
Dublin 12  
Phone: +353-1-4089 800  
Telefax: +353-1-4089 830

**Italy**

GRUNDFOS Pompe Italia S.r.l.  
Via Gran Sasso 4  
I-20060 Truccazzano (Milano)  
Tel.: +39-02-95838112  
Telefax: +39-02-95309290 / 95838461

**Japan**

GRUNDFOS Pumps K.K.  
Gotanda Metalion Bldg., 5F,  
5-21-15, Higashi-gotanda  
Shiagawa-ku, Tokyo  
141-0022 Japan  
Phone: +81 35 448 1391  
Telefax: +81 35 448 9619

**Korea**

GRUNDFOS Pumps Korea Ltd.  
6th Floor, Aju Building 679-5  
Yeoksam-dong, Kangnam-ku, 135-916  
Seoul, Korea  
Phone: +82-2-5317 600  
Telefax: +82-2-5633 725

**Latvia**

SIA GRUNDFOS Pumps Latvia  
Deglava biznesa centrs  
Augusta Deglava ielā 60, LV-1035, Rīga,  
Tālr.: + 371 714 9640, 7 149 641  
Fakss: + 371 914 9646

**Lithuania**

GRUNDFOS Pumps UAB  
Smolensko g. 6  
LT-03201 Vilnius  
Tel: + 370 52 395 430  
Fax: + 370 52 395 431

**Malaysia**

GRUNDFOS Pumps Sdn. Bhd.  
7 Jalan Peguam U1/25  
Glenmarie Industrial Park  
40150 Shah Alam  
Selangor  
Phone: +60-3-5569 2922  
Telefax: +60-3-5569 2866

**México**

Bombas GRUNDFOS de México S.A. de  
C.V.  
Boulevard TLC No. 15  
Parque Industrial Stiva Aeropuerto  
Apodaca, N.L. 66600  
Phone: +52-81-8144 4000  
Telefax: +52-81-8144 4010

**Netherlands**

GRUNDFOS Netherlands  
Veluwezoom 35  
1326 AE Almere  
Postbus 22015  
1302 CA ALMERE  
Tel.: +31-88-478 6336  
Telefax: +31-88-478 6332  
e-mail: info\_gnl@grundfos.com

**New Zealand**

GRUNDFOS Pumps NZ Ltd.  
17 Beatrice Tinsley Crescent  
North Harbour Industrial Estate  
Albany, Auckland  
Phone: +64-9-415 3240  
Telefax: +64-9-415 3250

**Norway**

GRUNDFOS Pumper A/S  
Strømsveien 344  
Postboks 235, Leirdal  
N-1011 Oslo  
Tlf.: +47-22 90 47 00  
Telefax: +47-22 32 21 50

**Poland**

GRUNDFOS Pompy Sp. z o.o.  
ul. Klonowa 23  
Baranowo k. Poznania  
PL-62-081 Przeźmierowo  
Tel: (+48-61) 650 13 00  
Fax: (+48-61) 650 13 50

**Portugal**

Bombas GRUNDFOS Portugal, S.A.  
Rua Calvet de Magalhães, 241  
Apartado 1079  
P-2770-153 Paço de Arcos  
Tel.: +351-21-440 76 00  
Telefax: +351-21-440 76 90

**România**

GRUNDFOS Pompe România SRL  
Bd. Biruintei, nr 103  
Pantelimon county Ilfov  
Phone: +40 21 200 4100  
Telefax: +40 21 200 4101  
E-mail: romania@grundfos.ro

**Russia**

ООО Грундфос  
Россия, 109544 Москва, ул. Школьная  
39  
Тел. (+7) 495 737 30 00, 564 88 00  
Факс (+7) 495 737 75 36, 564 88 11  
E-mail  
grundfos.moscow@grundfos.com

**Serbia**

GRUNDFOS Predstavništvo Beograd  
Dr. Milutina Ivkovića 2a/29  
YU-11000 Beograd  
Phone: +381 11 26 47 877 / 11 26 47  
496  
Telefax: +381 11 26 48 340

**Singapore**

GRUNDFOS (Singapore) Pte. Ltd.  
24 Tuas West Road  
Jurong Town  
Singapore 638381  
Phone: +65-6865 1222  
Telefax: +65-6861 8402

**Slovenia**

GRUNDFOS PUMPEN VERTRIEB  
Ges.m.b.H.,  
Podružnica Ljubljana  
Blatnica 1, SI-1236 Trzin  
Phone: +386 01 568 0610  
Telefax: +386 01 568 0619  
E-mail: slovenia@grundfos.si

**Spain**

Bombas GRUNDFOS España S.A.  
Camino de la Fuentecilla, s/n  
E-28110 Algete (Madrid)  
Tel.: +34-91-848 8800  
Telefax: +34-91-628 0465

**Sweden**

GRUNDFOS AB  
Box 333 (Lunnagårdsgatan 6)  
431 24 Mölndal  
Tel.: +46(0)771-32 23 00  
Telefax: +46(0)31-331 94 60

**Switzerland**

GRUNDFOS Pumpen AG  
Bruggacherstrasse 10  
CH-8117 Fällanden/ZH  
Tel.: +41-1-806 8111  
Telefax: +41-1-806 8115

**Taiwan**

GRUNDFOS Pumps (Taiwan) Ltd.  
7 Floor, 219 Min-Chuan Road  
Taichung, Taiwan, R.O.C.  
Phone: +886-4-2305 0868  
Telefax: +886-4-2305 0878

**Thailand**

GRUNDFOS (Thailand) Ltd.  
92 Chaloen Phrakiat Rama 9 Road,  
Dokmai, Pravej, Bangkok 10250  
Phone: +66-2-725 8999  
Telefax: +66-2-725 8998

**Turkey**

GRUNDFOS POMPA San. ve Tic. Ltd.  
Sti.  
Gebze Organize Sanayi Bölgesi  
Ihsan dede Caddesi,  
2. yol 200. Sokak No. 204  
41490 Gebze/ Kocaeli  
Phone: +90 - 262-679 7979  
Telefax: +90 - 262-679 7905  
E-mail: satis@grundfos.com

**Ukraine**

ТОВ ГРУНДФОС УКРАЇНА  
01010 Київ, Вул. Московська 86,  
Тел.: (+38 044) 390 40 50  
Факс.: (+38 044) 390 40 59  
E-mail: ukraine@grundfos.com

**United Arab Emirates**

GRUNDFOS Gulf Distribution  
P.O. Box 16768  
Jebel Ali Free Zone  
Dubai  
Phone: +971-4- 8815 166  
Telefax: +971-4-8815 136

**United Kingdom**

GRUNDFOS Pumps Ltd.  
Grovebury Road  
Leighton Buzzard/Beds. LU7 8TL  
Phone: +44-1525-850000  
Telefax: +44-1525-850011

**U.S.A.**

GRUNDFOS Pumps Corporation  
17100 West 118th Terrace  
Olathe, Kansas 66061  
Phone: +1-913-227-3400  
Telefax: +1-913-227-3500

**Uzbekistan**

Представительство ГРУНДФОС в  
Ташкенте  
700000 Ташкент ул.Усмана Носира 1-й  
тулик 5  
Телефон: (3712) 55-68-15  
Факс: (3712) 53-36-35

<b>95047490</b> 0908	<b>GB</b>